
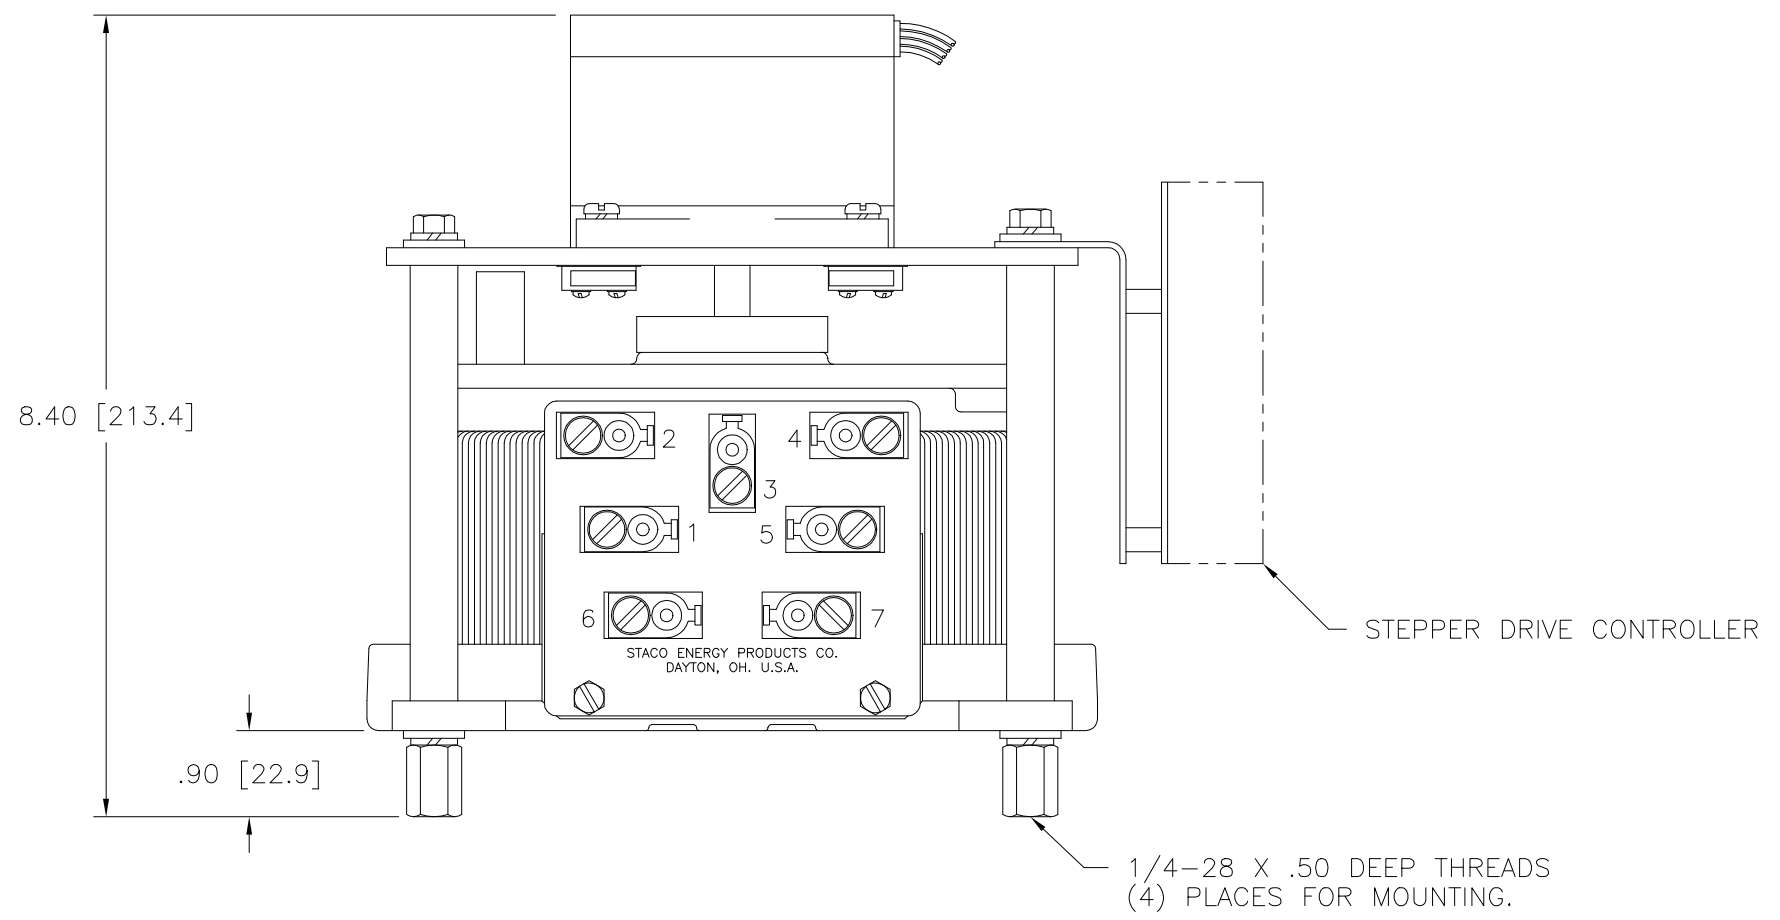

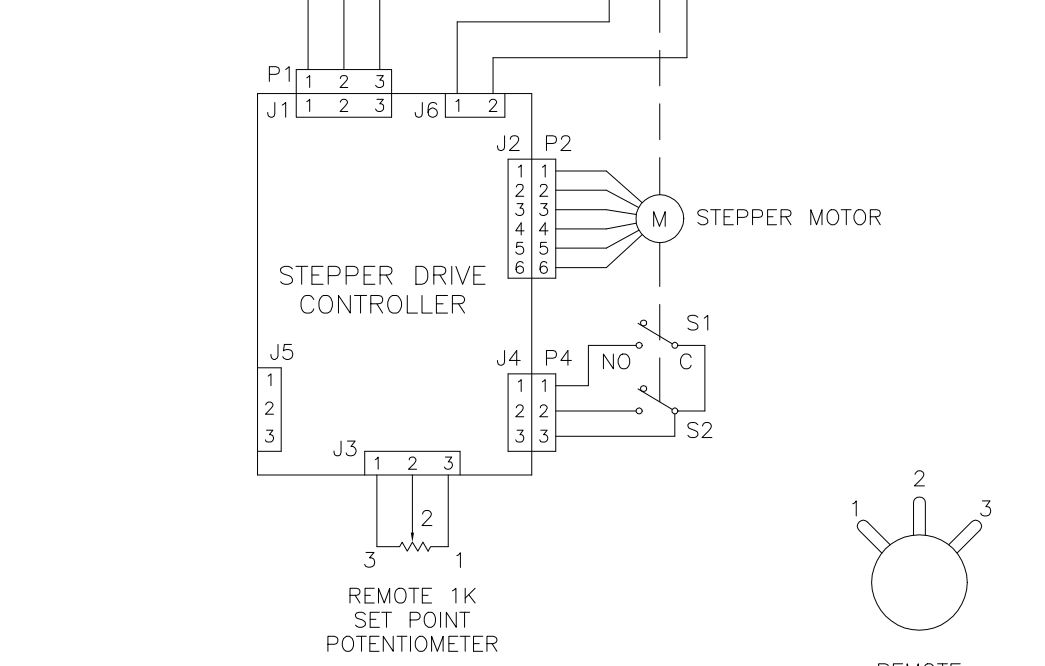
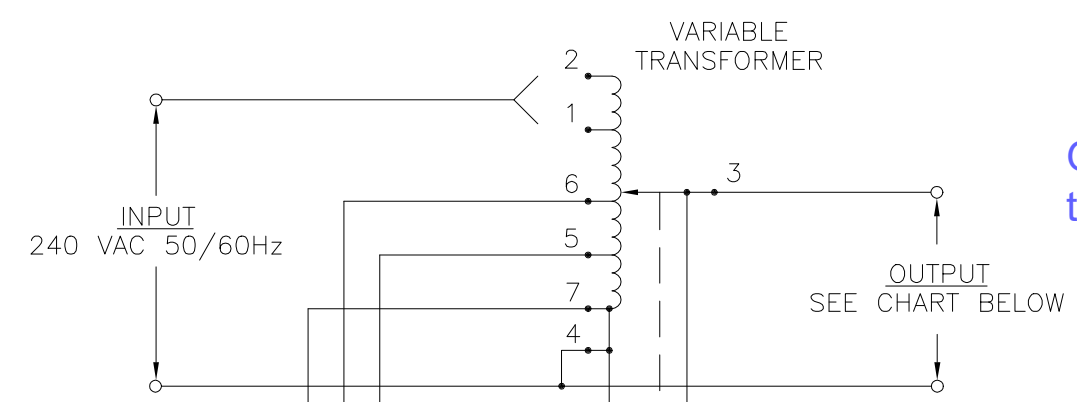


DWG. NO.	095-1808		
REVISIONS			
SYM.	E.C.N.	DATE	APVD.
A	24028	8/18/99	
CLARIFIED 5VDC NOTE			

Go to VARIAC.com
to purchase and for
technical support.
Made in the USA

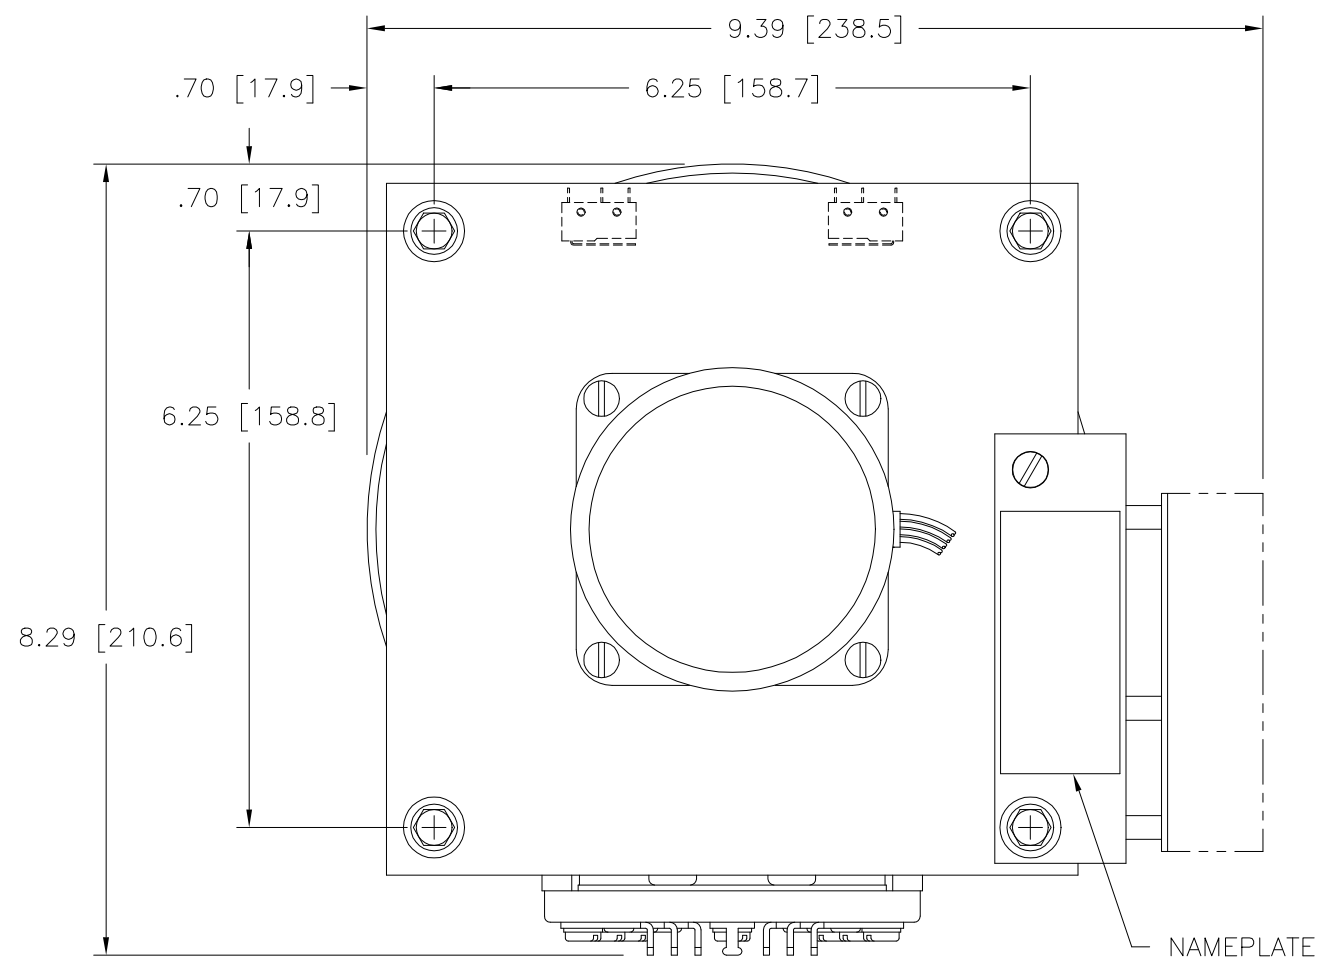

SET POINT ADJUSTMENT:
THE OUTPUT SET POINT MAY BE ADJUSTED WITH THE REMOTE 1K POTENTIOMETER PROVIDED OR WITH A 0-5 VDC SIGNAL TO THE J3 CONNECTOR ON THE STEPPER DRIVE CONTROL. MAKE CONNECTIONS TO J3-2(+) & J3-3(-). A NOMINAL +5 VDC SETPOINT SUPPLY IS AVAILABLE AT J3-1 (ADJUSTABLE AT TRIMPOT R22).

SPECIFICATIONS									
WIRING	INPUT		OUTPUT				TERMINAL CONNECTIONS		
	VOLTS	HERTZ	VOLTS	CONSTANT CURRENT LOAD	CONSTANT IMPEDANCE LOAD		INPUT	OUTPUT	
SINGLE PHASE	240	50/60		MAX. AMPS	MAX. KVA	MAX. AMPS	MAX. KVA	2-4	4-3
			0-240	10	2.40	13	3.12	1-4	4-3
			0-280	10	2.80	-	-		

UNLESS OTHERWISE SPECIFIED, TOLERANCE IS #		UNITS		TITLE:		DRAWN BY		DATE		FIRST USED ON		DO NOT SCALE DWG.		CUSTOMER APPROVAL		DATE			
DECIMALS	Holes	ANGLES	DRAFT	IN	MM	SPEC. CONTROL DRAWING STEPPER DRIVEN VARIABLE TRANSFORMER MODEL SD2520						S.A. SMITH		12/19/95					
.XX	.0005	.002	1°	1-1/2*								CHECKER		DATE		SCALE			
MATERIAL:				ALL DIMENSIONS APPLY AFTER PLATING								ENGINEER		DATE		SCALE 1=1		SHEET 1 OF 1	
<small>The information and design disclosed herein was originated by and is the property of STACO ENERGY PRODUCTS CO., which reserves all patent, proprietary, design, manufacturing, reproduction, use and sale rights thereto, and to any article disclosed therein except to the extent rights are expressly granted to others. The foregoing does not apply to vendor proprietary parts.</small>																			
DWG. NO.		095-1808																	

